




SIDEWALK DETAIL

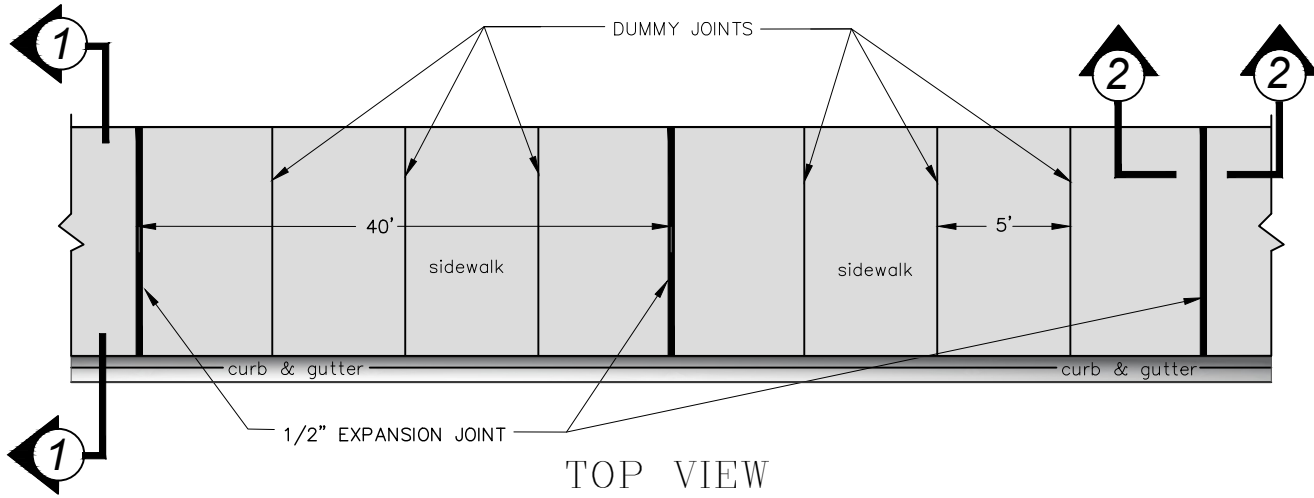

TOP VIEW

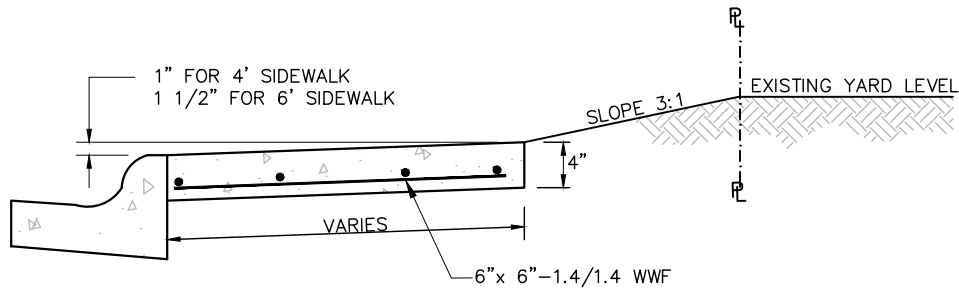

Section 1-1

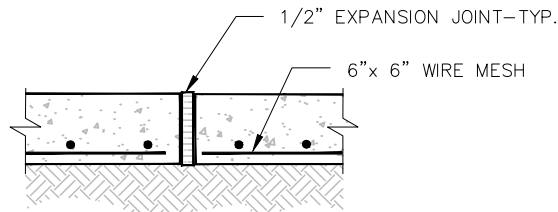

Section 2-2

GENERAL NOTES:

1. THE ABOVE TYPICAL SIDEWALK DETAILS FIT MOST CONDITIONS, HOWEVER EXISTING FIELD CONDITIONS MAY DICTATE A VARIANCE FROM THESE DETAILS.
2. THE CONTRACTOR MAY ENCOUNTER CUT OFF POWER POLES, CONCRETE POLE FOOTINGS, AND OTHER OBJECTS THAT HE SHALL REMOVE TO A MINIMUM OF 4" BELOW FINISHED GRADE.
3. SIDEWALK SLOPE IS 1/4" PER FOOT.
4. (1/2") EXPANSION JOINT MATERIAL SHALL BE PLACED AT 40' INTERVALS IN NEW SIDEWALK, AT EACH (PC), AND AT EACH SIDE OF THE DRIVE APPROACH.
5. DUMMY JOINTS SHALL BE INSTALLED EVERY 5'.

DRAWN BY: Liz A
 DATE: June 23, 2016
 SCALE: N.T.S.