



## TYPICAL 2" WATER SERVICE CONNECTION WITH ANGLED BALL VALVE FOR WATER MAINS DEEPER THAN 5'

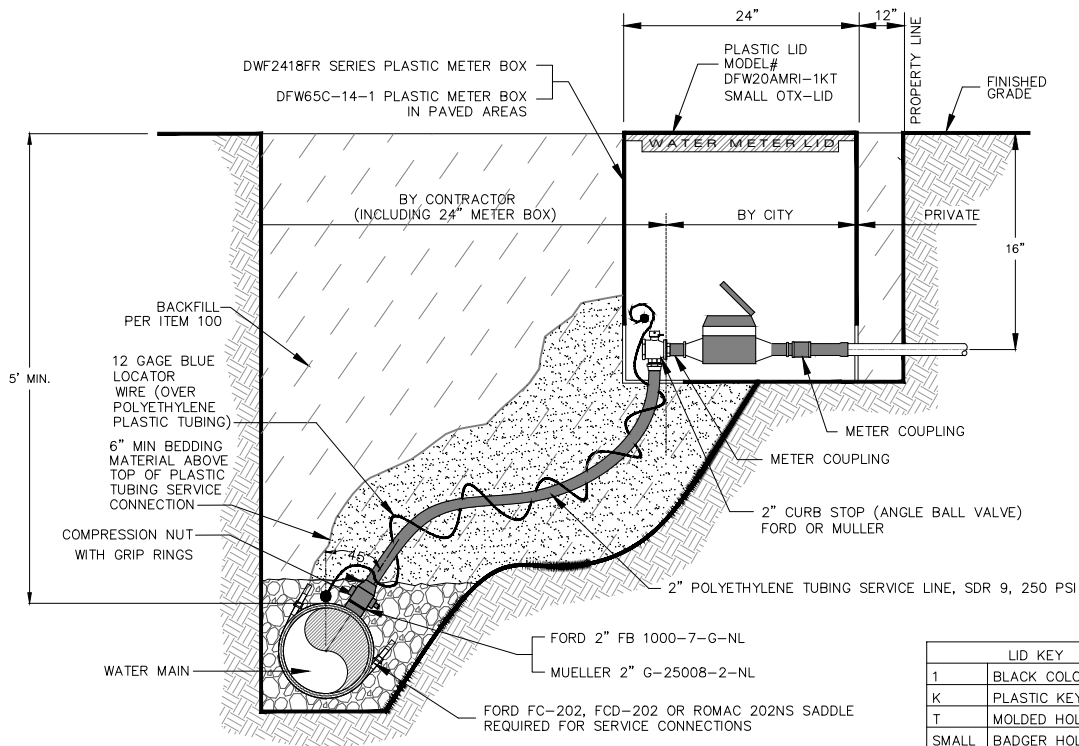

LID KEY	
1	BLACK COLOR
K	PLASTIC KEY LOCK
T	MOLDED HOLE
SMALL	BADGER HOLE
OTX	ODESSA, TEXAS

**CONTRACTORS SHALL REPAIR / REPLACE CURB AND SIDEWALK AS NECESSARY FOR INSTALLATION OF SERVICES**

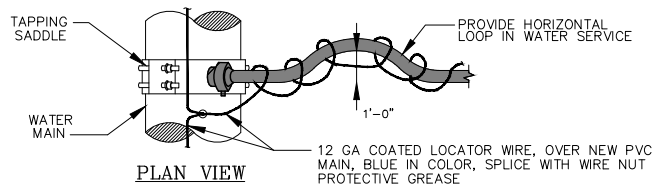

**NOTE:**

- ALL BRASS GOODS MUST COMPLY TO AWWA SPECS. ON.C-800-55
- DO NOT CONNECT LOCATOR WIRE TO CORPORATION CHECK OR CURB STOP

**GENERAL NOTES:**

- THE UTILITY CONTRACTOR IS TO INSTALL A NEW SERVICE LINE AT EACH INDIVIDUAL LOT OR TRACT. WATER SERVICE SHALL BE LOCATED 5' TO THE RIGHT OF THE CENTER LINE OF THE LOT WHEN VIEWED FROM THE MAIN.
- THE SIZE OF THE SERVICE LINE IS TO BE AS NOTED ON THE PLAN SHEETS.
- UPON COMPLETION OF THE SERVICE LINE, THE CONTRACTOR WILL LEAVE THE CORPORATION STOP OPEN AND THE CURB STOP CLOSED.
- THE SERVICE LINE UP TO THE CURB STOP WILL BE INCLUDED IN THE STERILIZATION AND PRESSURE TESTING OF THE WATER MAIN.
- THE BACKFILL AND CLEANUP REQUIREMENTS FOR SERVICE LINES ARE THE SAME AS ON WATER MAINS.
- SERVICE CONNECTIONS SHALL NOT BE IN PAVED AREAS. BOXES SHOULD NOT BE IN TRAFFIC AREA UNLESS APPROVED BY THE CITY.
- PROTECTIVE WRAPPING SHALL BE INSTALLED AROUND SERVICE SADDLE

**DRAWN BY: MSotelo**  
**DATE: MAY, 2022**  
**SCALE: N.T.S.**